


# Heating, Ventilation and Air Conditioning

## FCC/S 1.x.x.1: There are no changes via i-bus tool possible. Config mode can't be enabled. Why?

The access via i-bus tool can be set in the parameters. In this case the access can be restricted.

Access to i-bus Tool

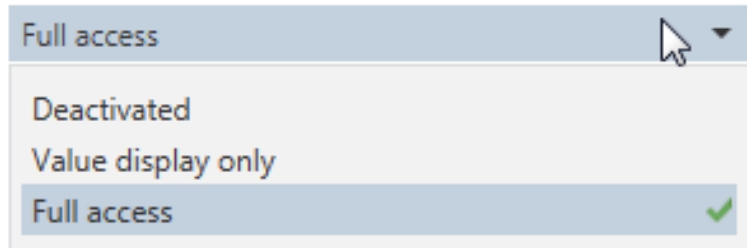

Unique solution ID: #1586

Author: Marcel Feuerstein

Last update: 2018-07-05 15:58