


Heating, Ventilation and Air Conditioning

AC/S 1.x.1: Is it possible to change outside the DCA the settings of the flags for the communication objects of the ASM?

Yes, it is. The changes are saved when switching to the DCA. But for example with the value ASM, please be careful because the different templates have predefined flags!

This means: "Last change wins" (DCA or ETS)

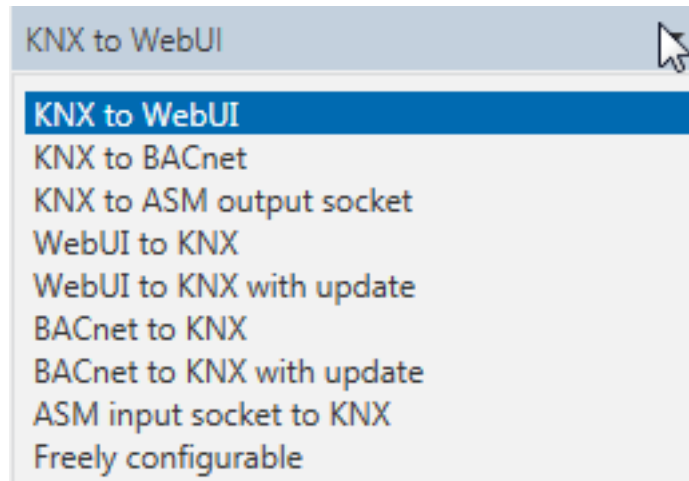

Unique solution ID: #1670

Author: BA Engineering Team

Last update: 2019-04-02 14:51